
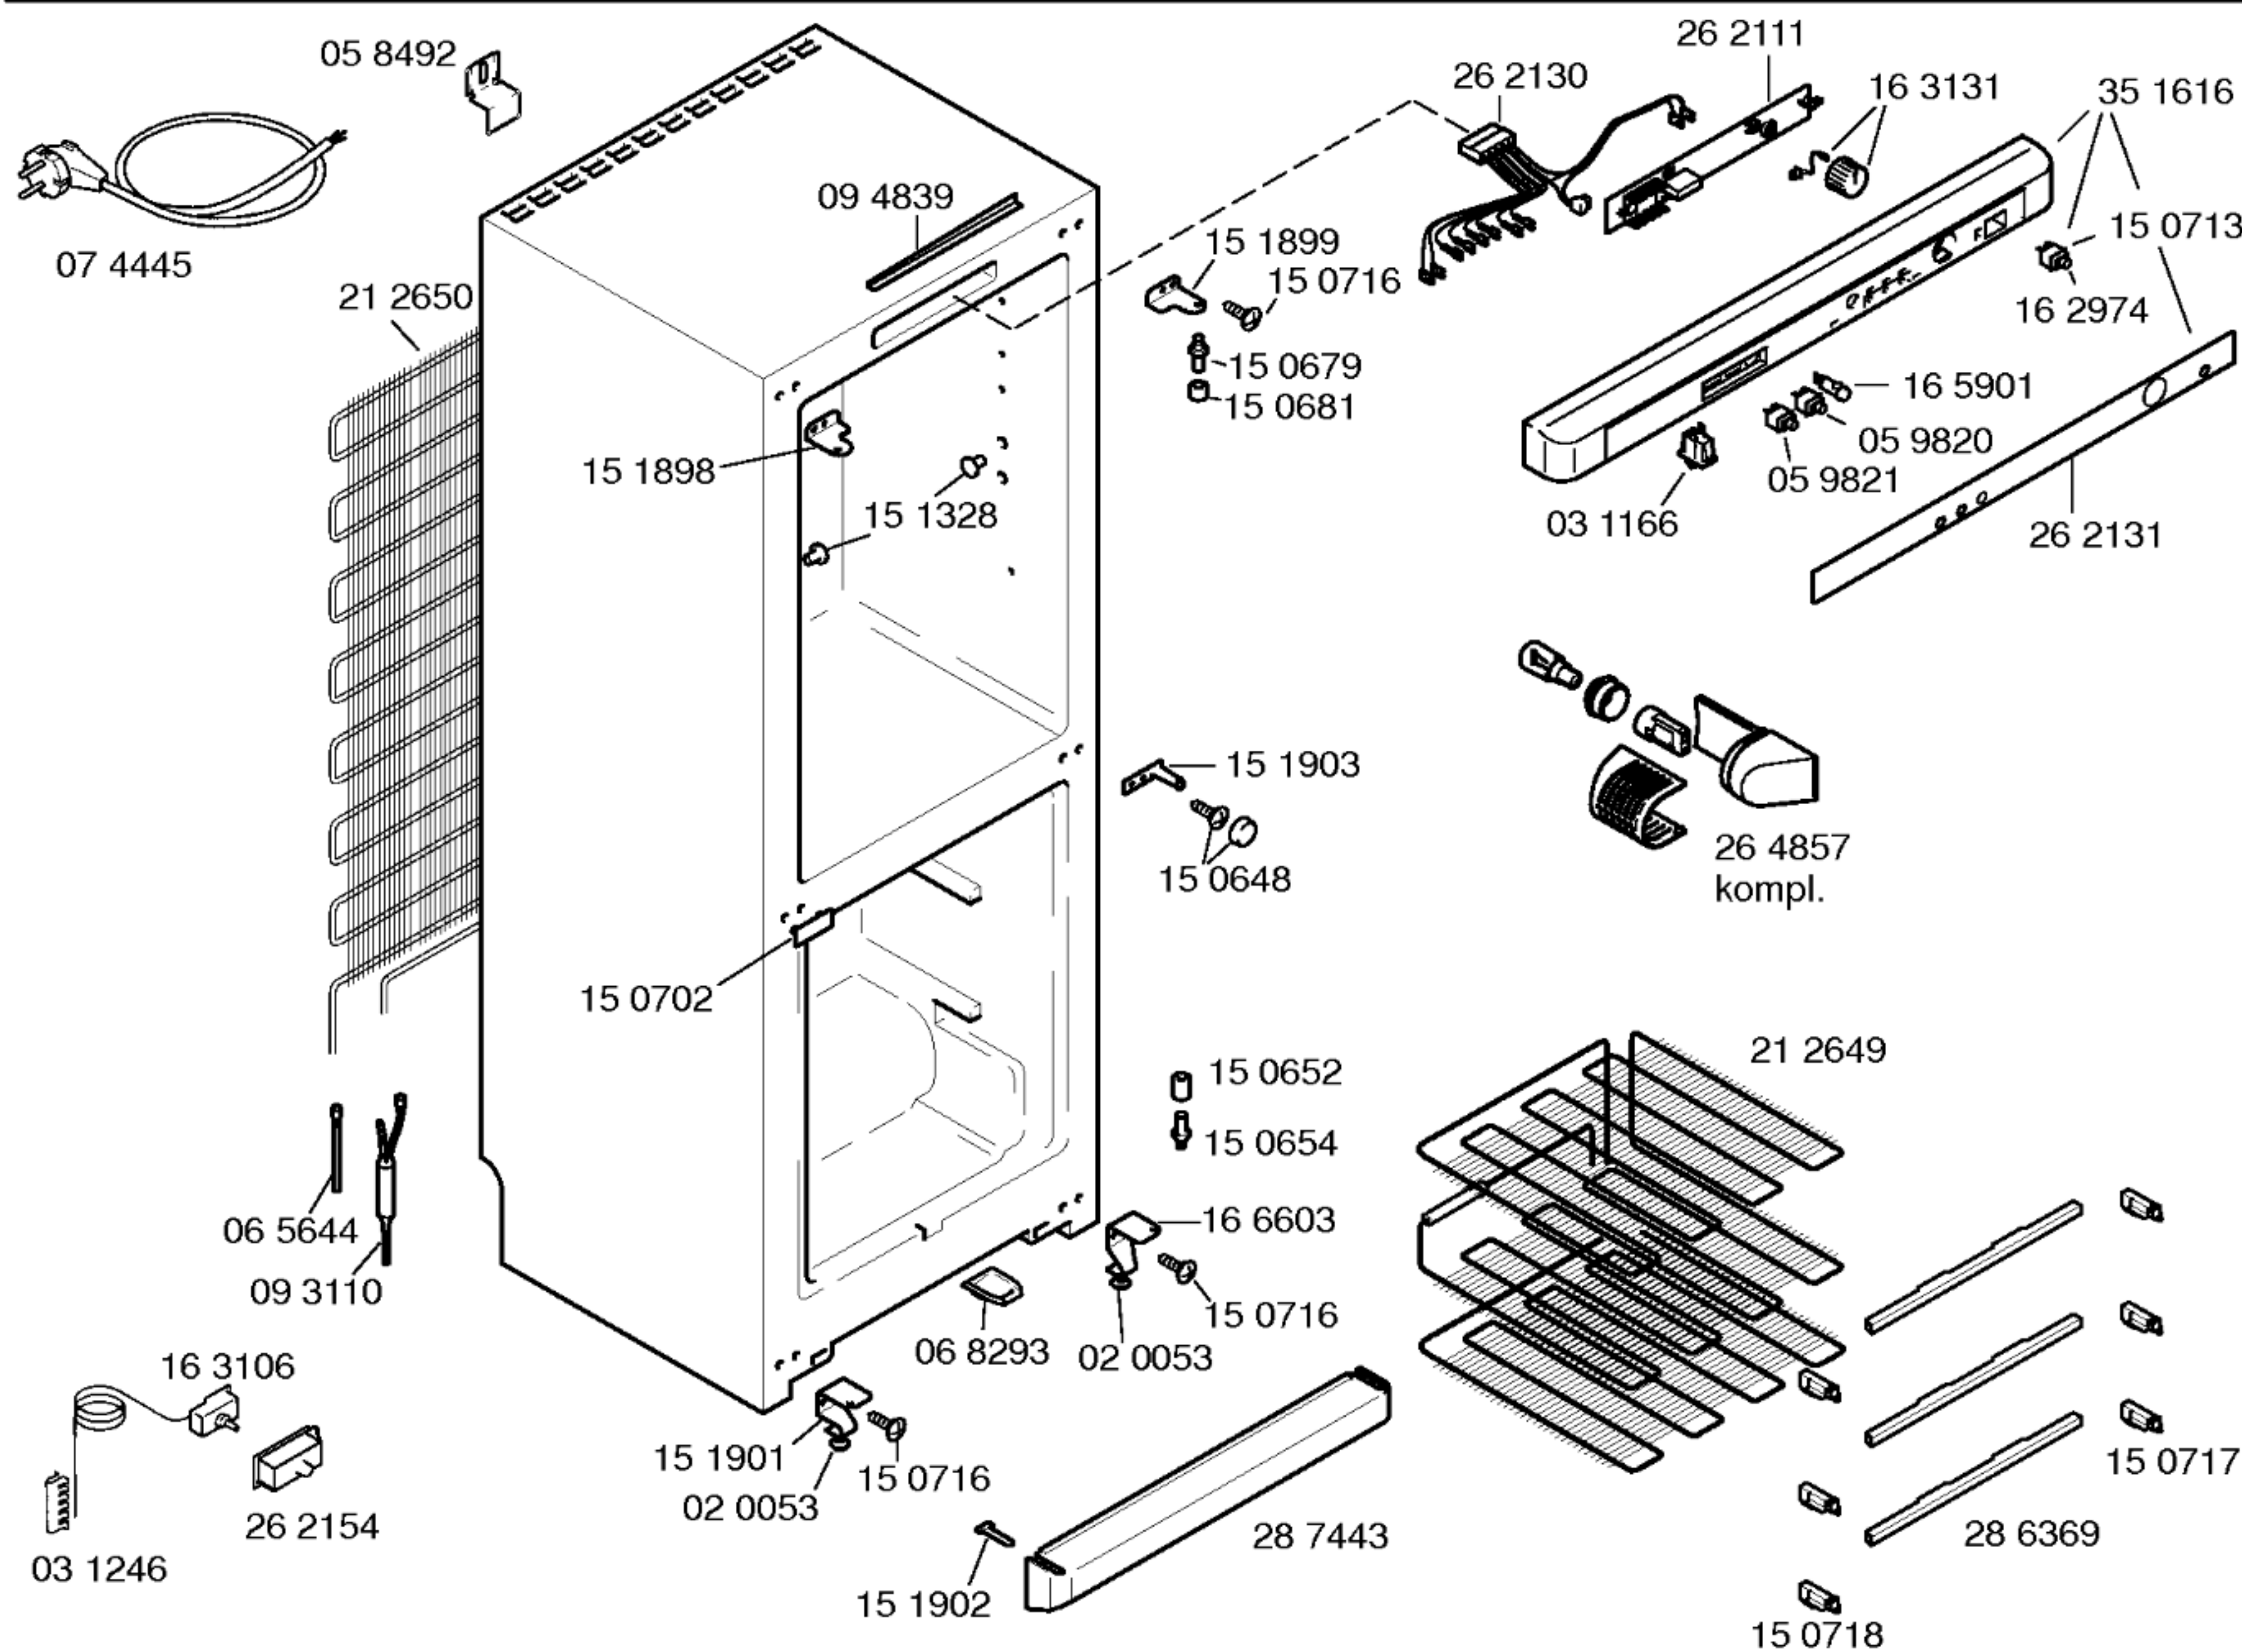
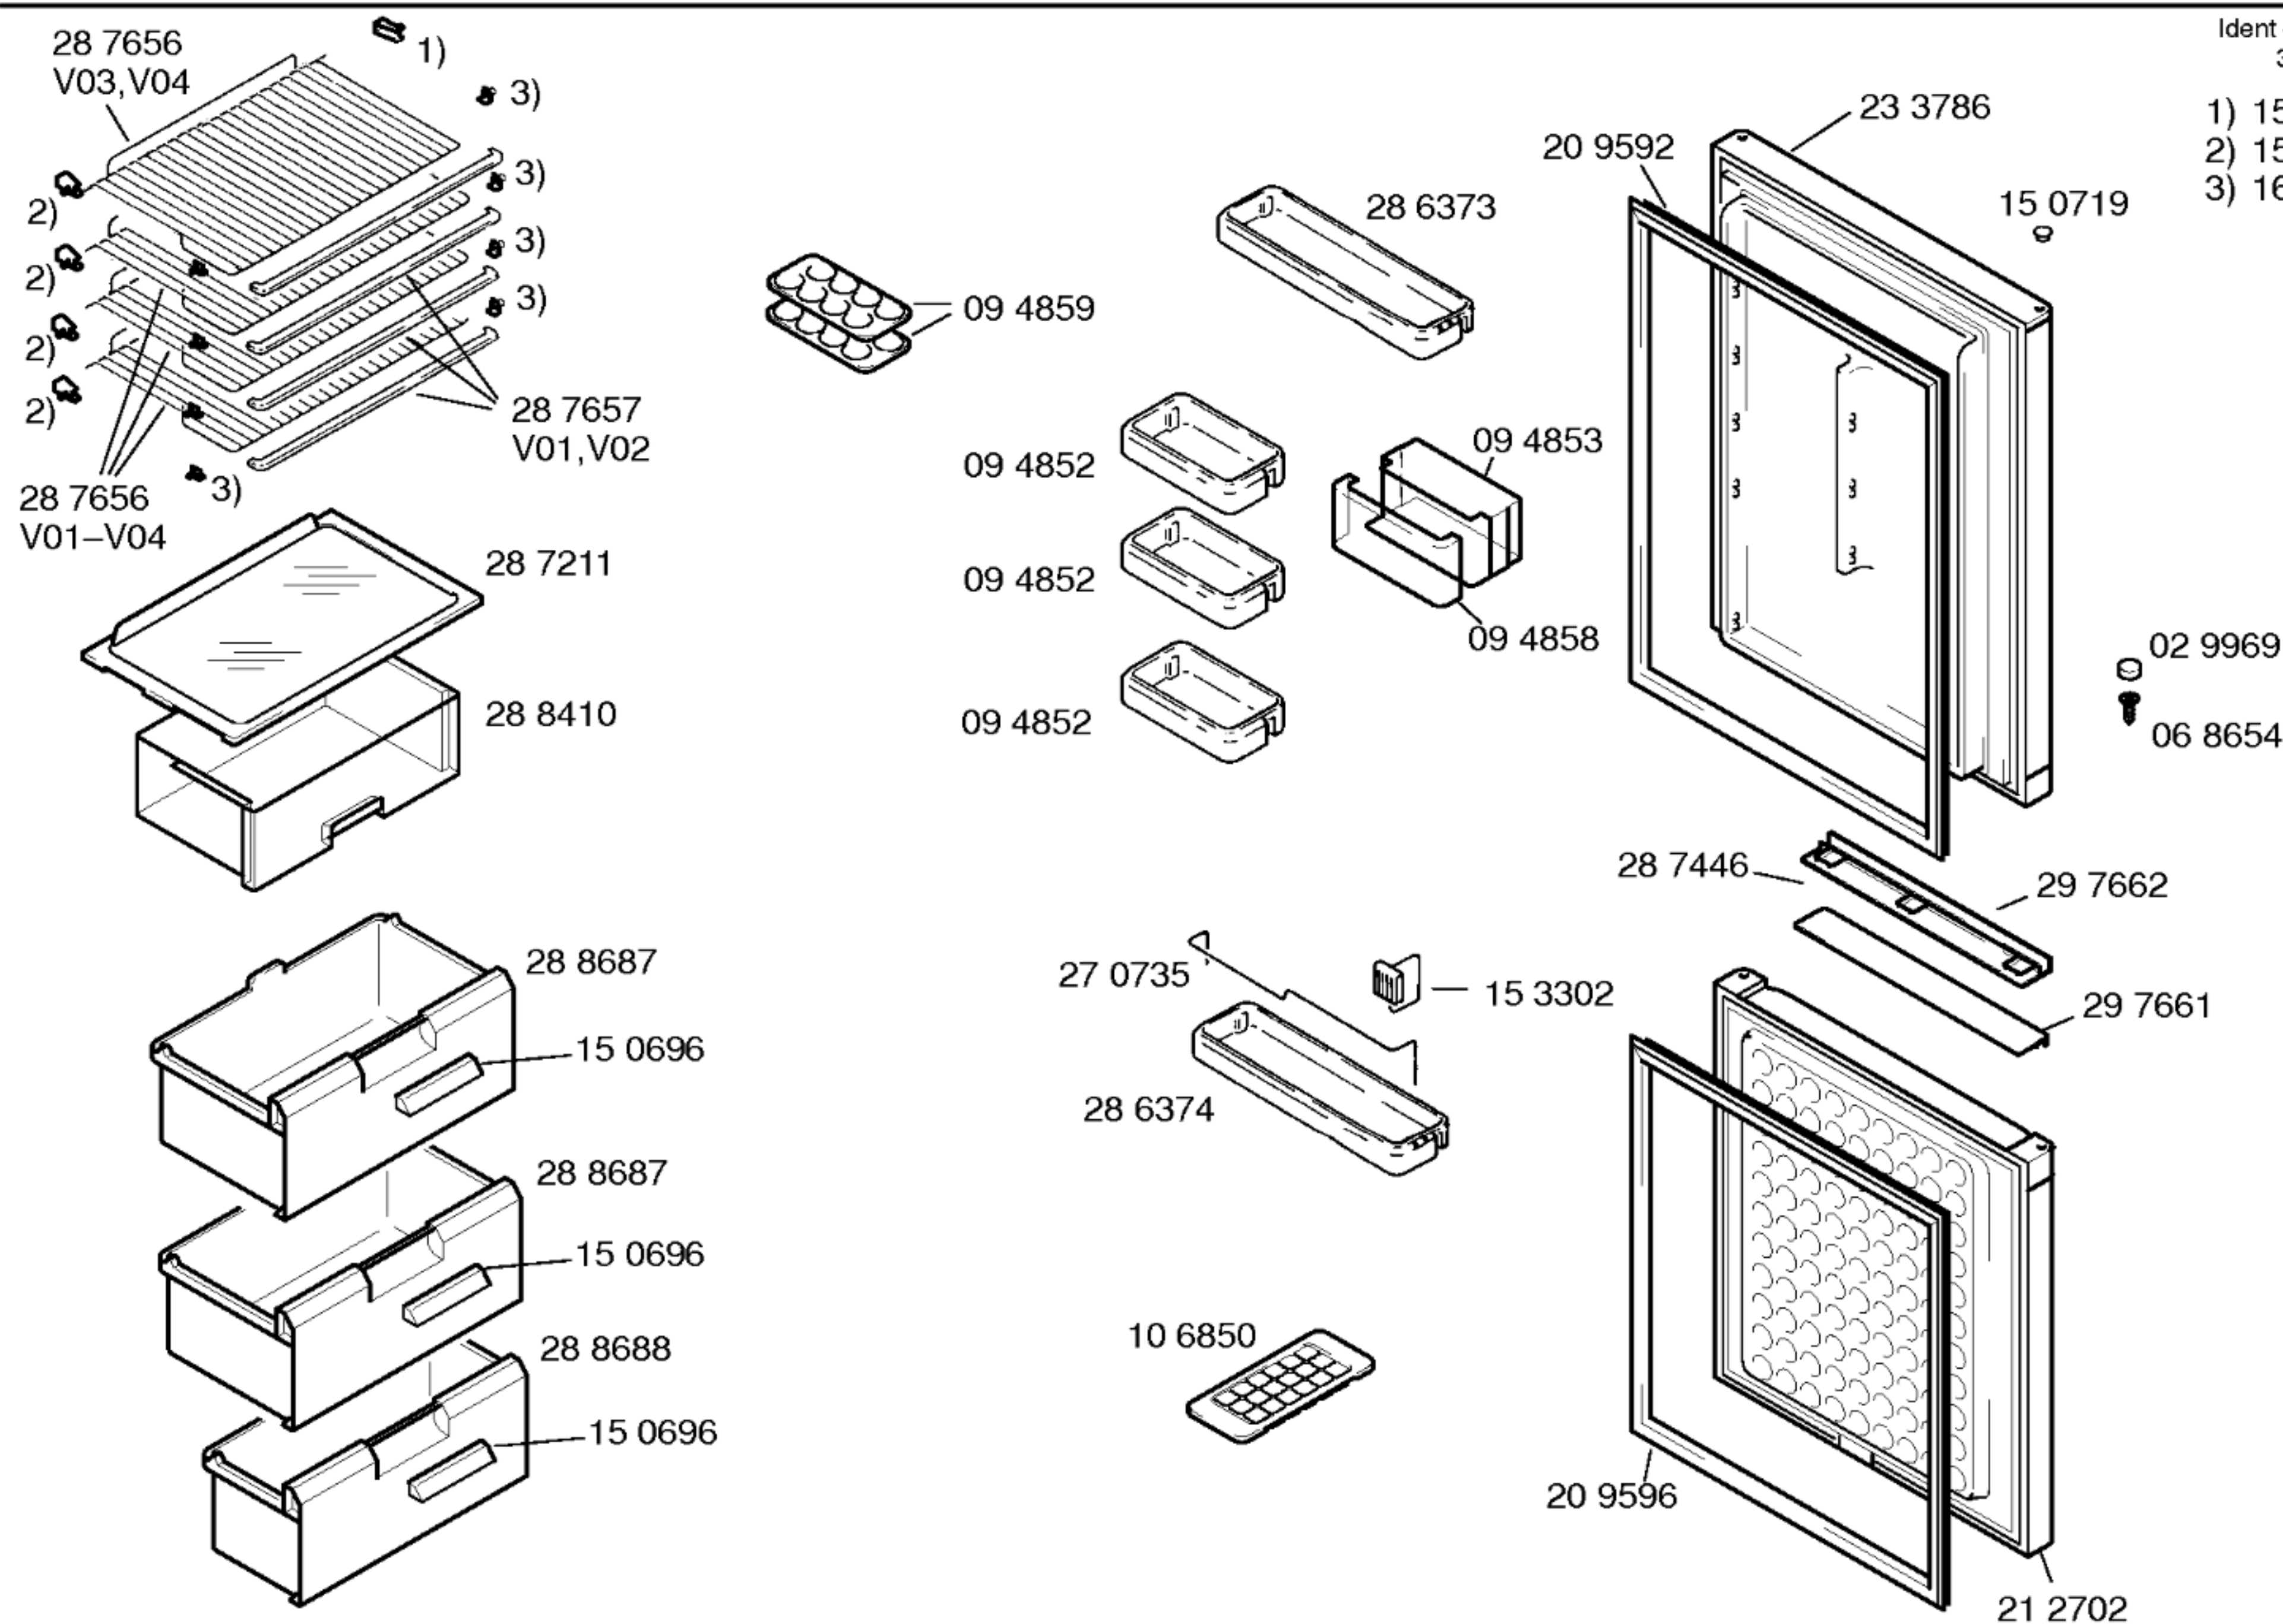



Ident – Nummern – Konstante
3740

Gebrauchsanweisung
52 1252
(D,GB,I,F,NL,DK,SF,S,
E,P,N)
Montageanleitung
51 6997
(D,G,I,F,NL,DK,N,SF,P)

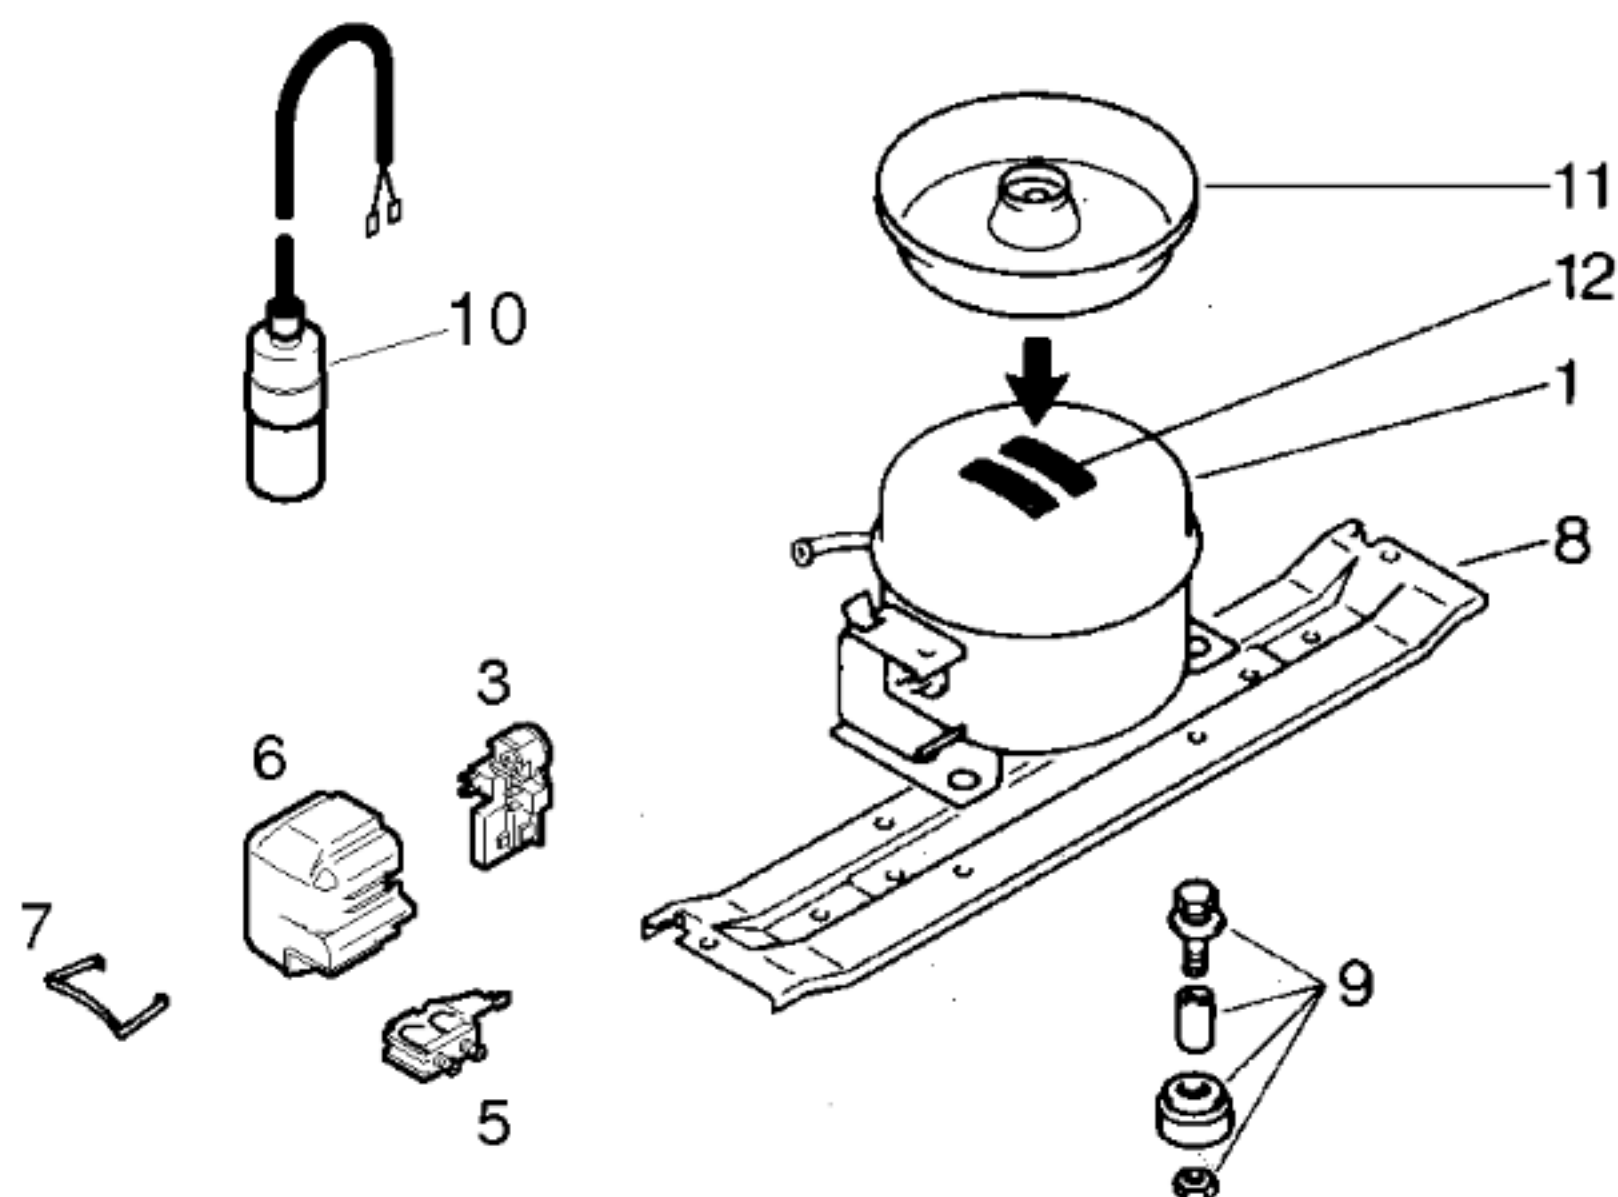

Ident – Nummern – Konstante
 3740


Pos.	KS	GS	
	Matsushita	Matsushita	
	SD 65 E	SD 65 E	
1	14 1316	14 1316	
2			
3	15 3306	15 3306	
4			
5	15 3865	15 3865	
6	15 3303	15 3303	
7			
8	29 7385	29 7385	
9	15 3364	15 3364	
10			
11	29 7386		
12			

TECHNISCHE DATEN / TECHNICAL DATA / DONNEES TECHNIQUES				KS	GS
Verdichter/Compressor/Compresseur				Matsushita	Matsushita
Typ/Type				SD 65 E	SD 65 E
Förderleistung/Delivery/Débit		l/h		1170	1170
Anlaufstrom/Starting current/Cour de démarrage		A		6,0	6,0
Widerstand/Resistance/Résistance		Ha/main/prin. Ω		29,8	29,8
		Hi/aux Ω		31,8	31,8
Temp.-Regler/Thermostat				Elektronisch	Kapilar
Typ/Type					Danfoss
Reglerstellung/Position				kalt	warm
Schaltwerte/Switching values/		„ein“ $^{\circ}\text{C}$		+5	+11
Valeurs de commutation		„aus“		29,6	-19,5
		(„abtauen“ od.) „alarm“			-20,5
					-26,5
					-16,0
Füllmenge/Fill.quantity/Charge		R600a g		*	*
Anschlußwert/Conn.load/Puiss. connectée		W		78	78
Heizung/Heater/Chauffage					
Widerstand/Resistance/Résistance		Ω			
Leistung/Power/Puissance		W			
Ventilator/Blower/Ventilateur					
Widerstand/Resistance/Résistance		Ω			
Schaltuhr/Timer/Minuterie de contact					
Widerstand/Resistance/Résistance		Ω			
Verdampferfühlerwerte				5 $^{\circ}\text{C}$ = 4,5k Ω	
				11 $^{\circ}\text{C}$ = 9,49k Ω	
				-19,5 $^{\circ}\text{C}$ = 47,2k Ω	
				-29,5 $^{\circ}\text{C}$ = 86,1k Ω	

* siehe Typenschild