

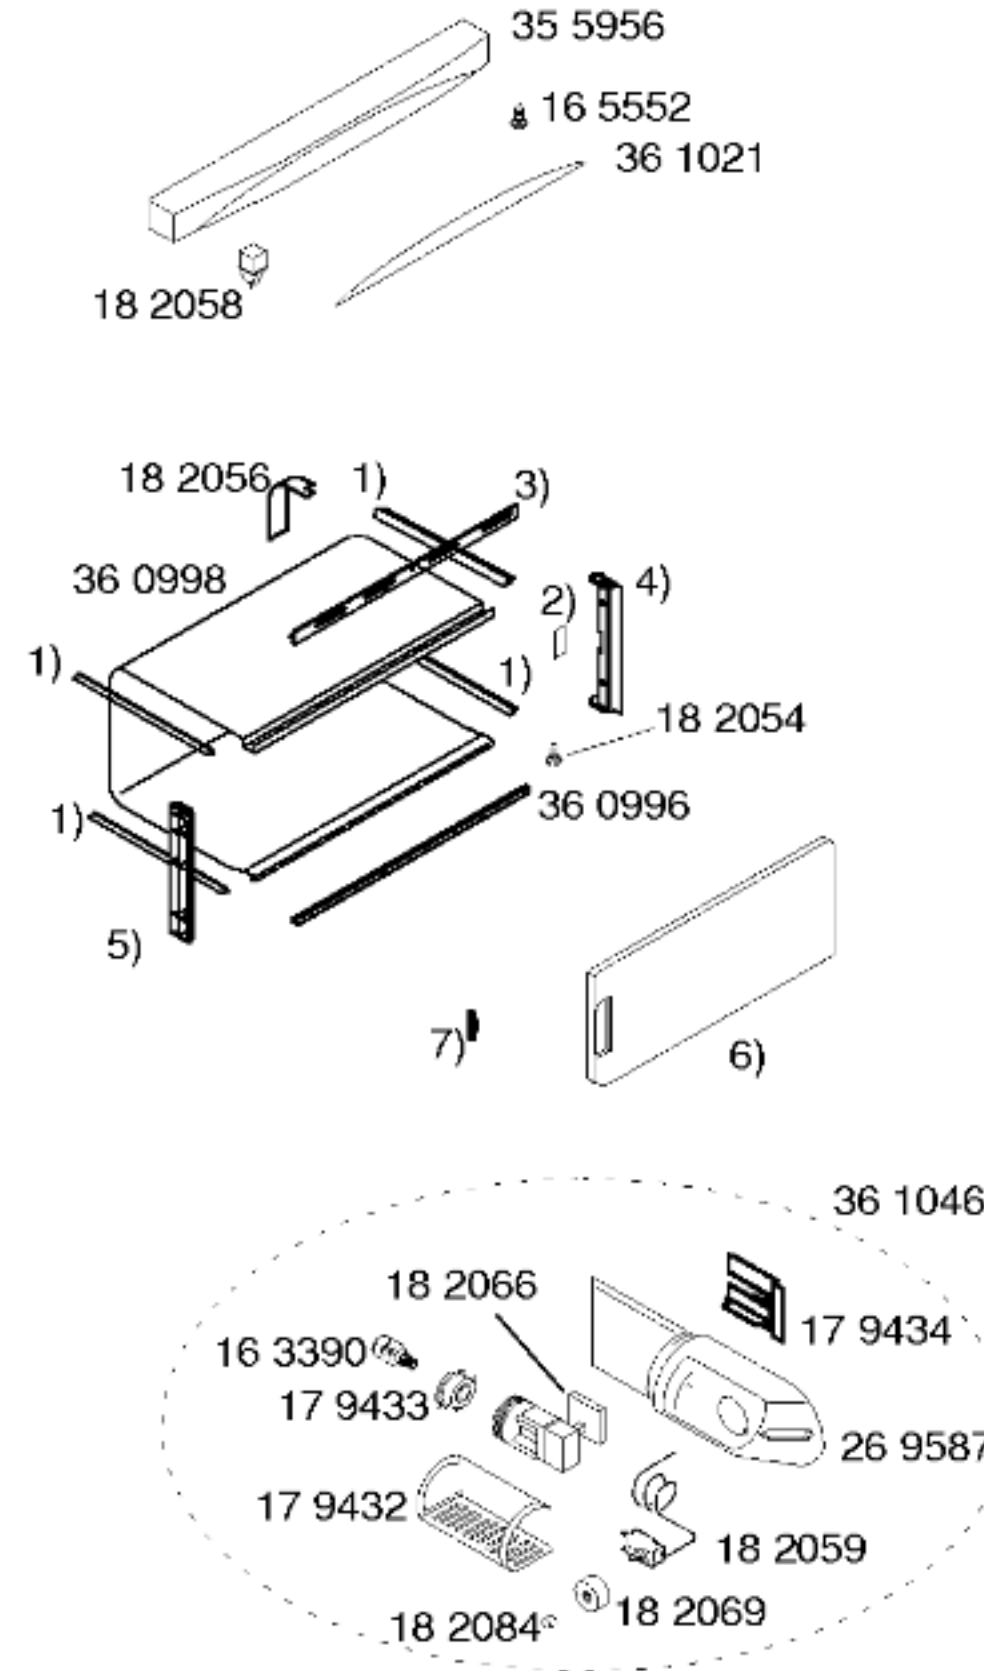


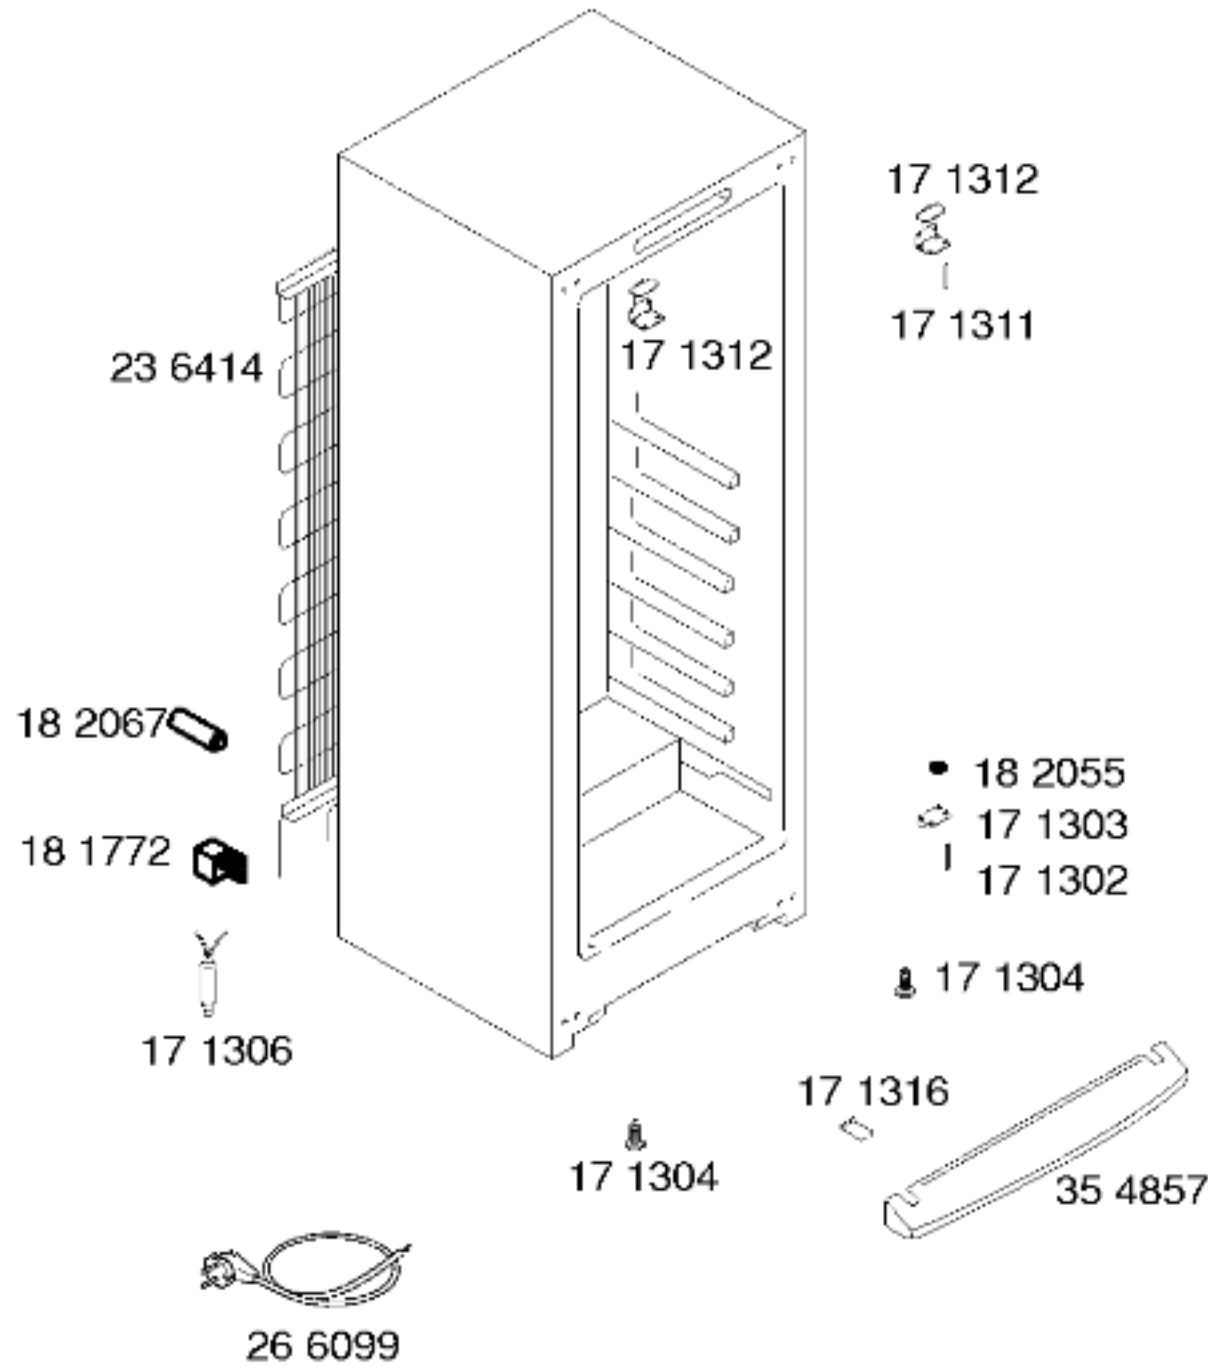


Kullanma kilavuzu
52 7932
(TR)

- 1) 48 0752
- 2) 18 2057
- 3) 36 0997
- V01,V02,V03,V04
- 36 0996
- V05,V06
- 4) 48 0753
- V01,V02,V03,V04
- 48 4112
- V05,V06
- 5) 48 0754
- V01,V02,V03,V04
- 48 4111
- V05,V06
- 6) 36 1019
- V01,V02,V03,V04
- 36 7047
- V05,V06
- 7) 18 2026
- V01,V02,V03,V04

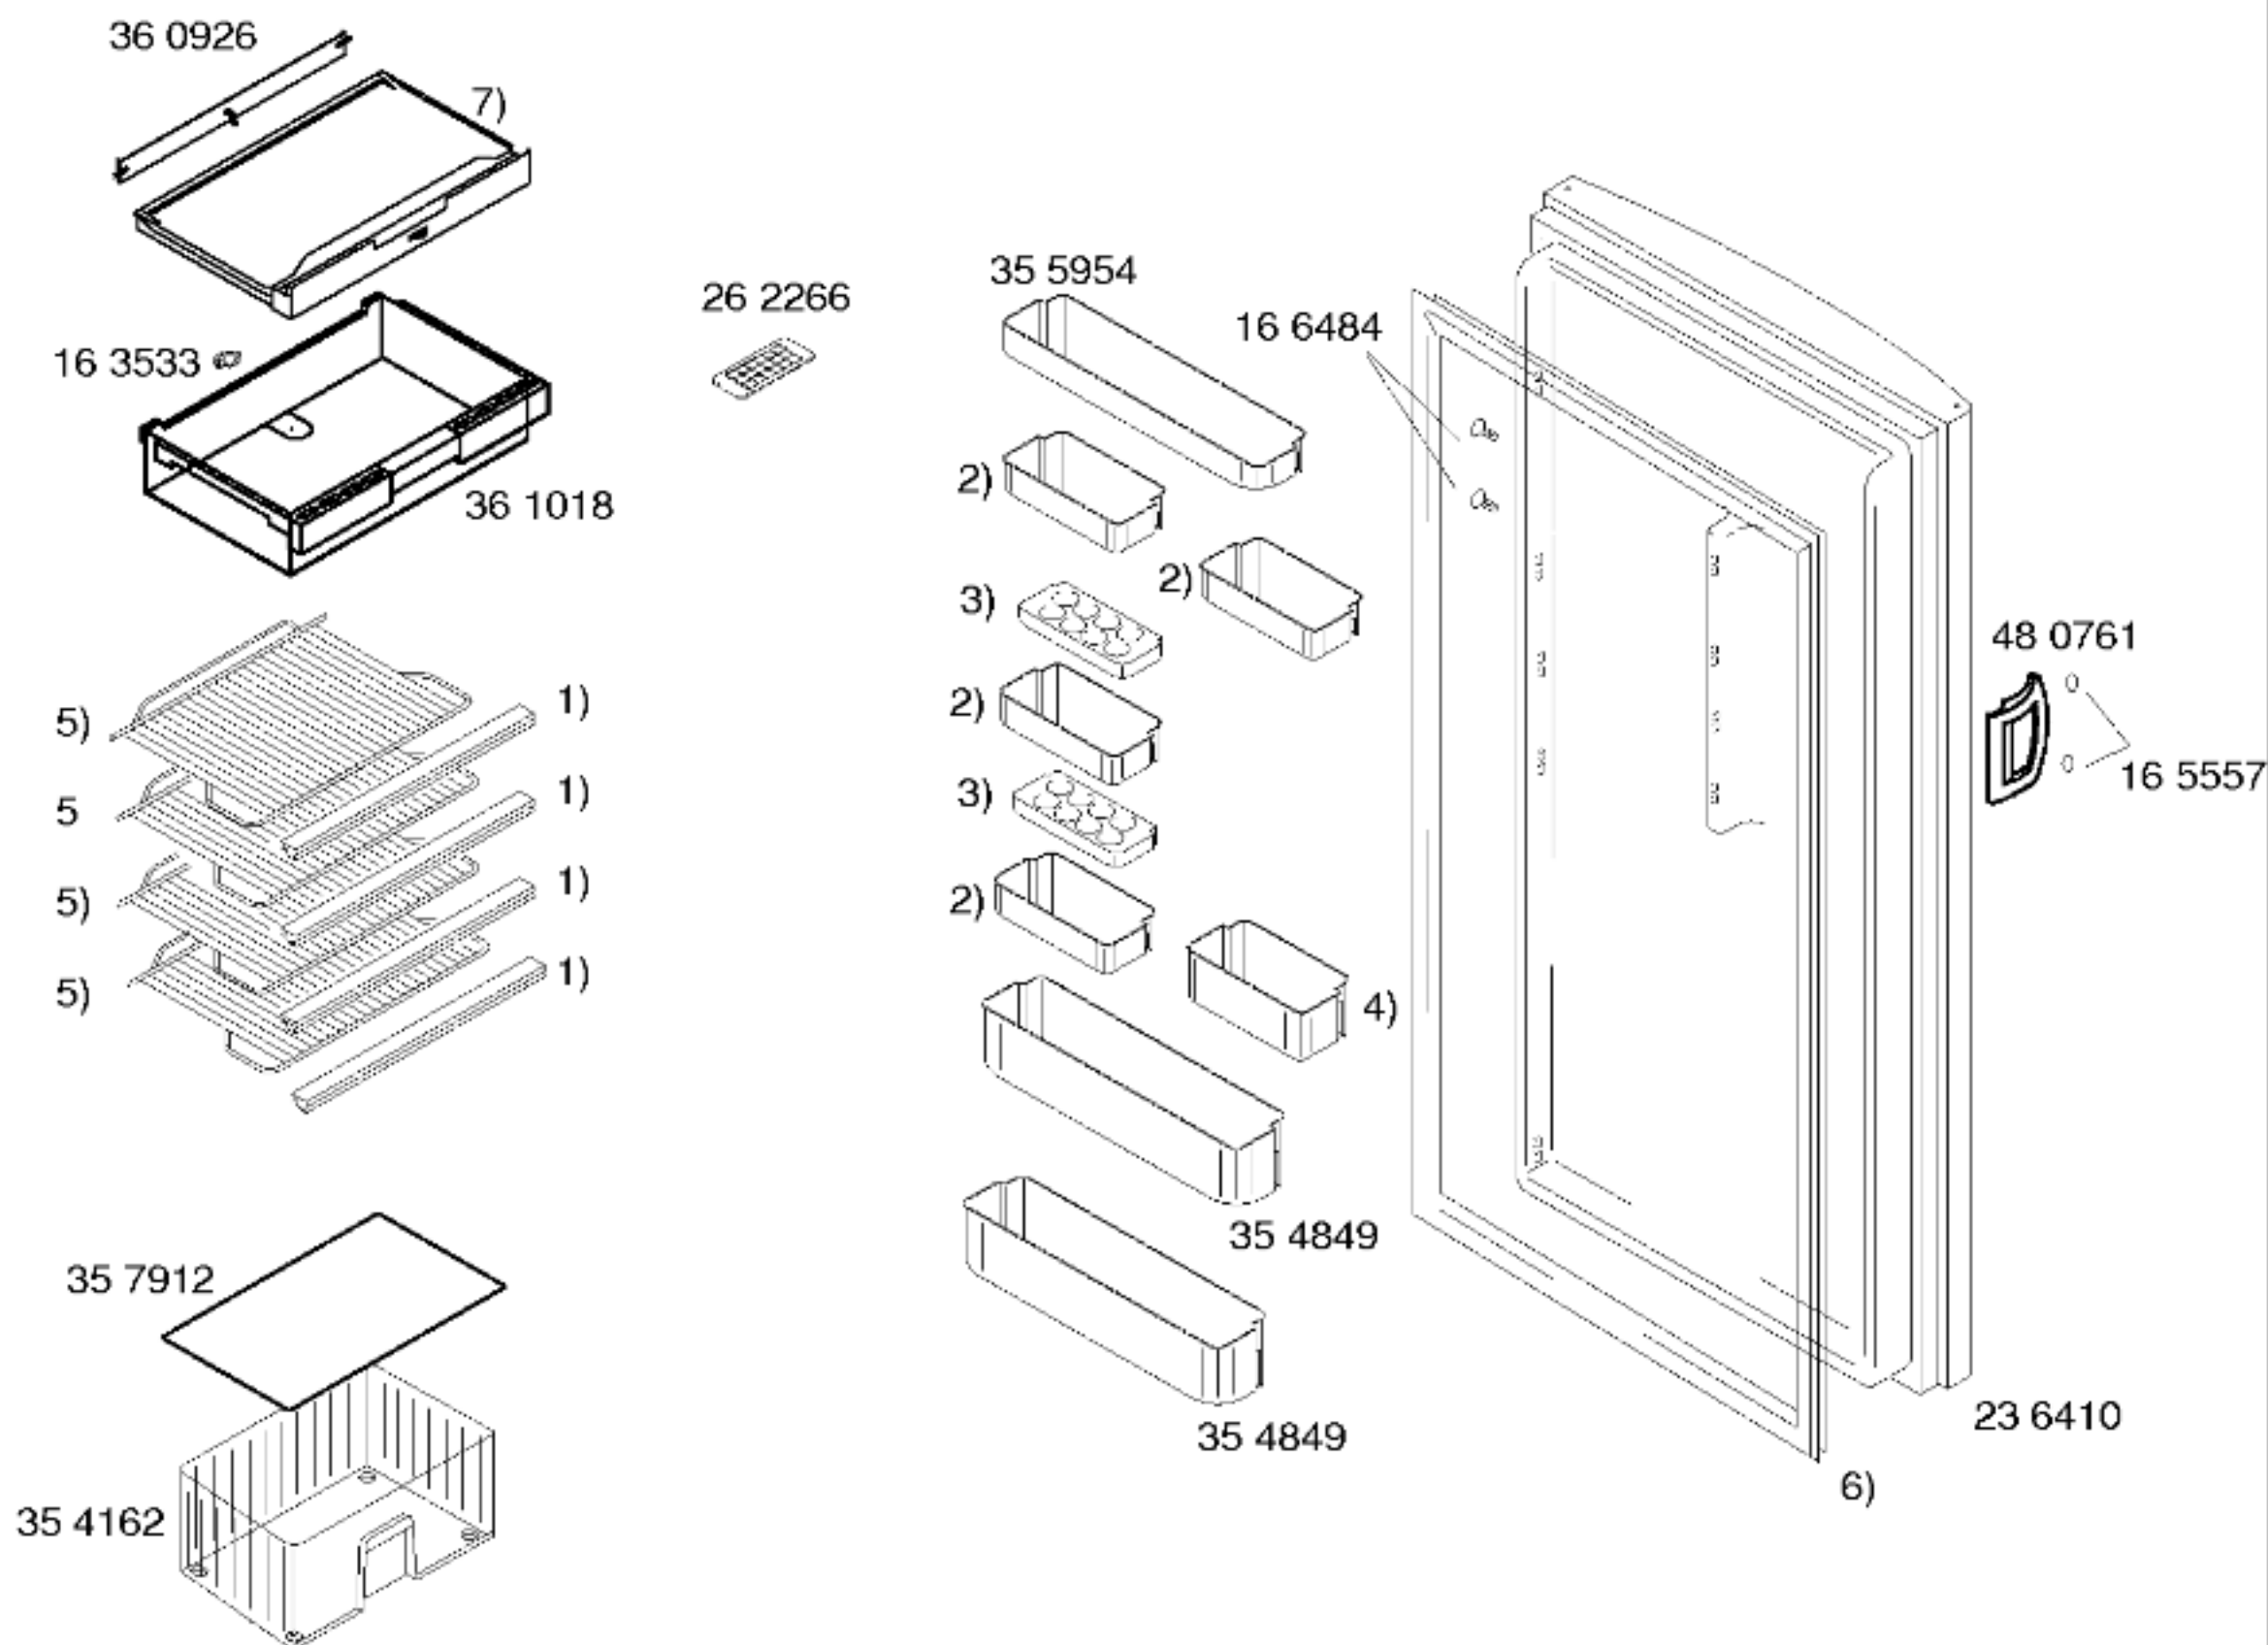

- 1) 35 4164
- 2) 26 7020
- 3) 26 6470
- 4) 26 7021
- 5) 36 0994
- 6) 23 6408
- V01,V02,V03,V04
- V05
- 23 8414
- V06
- 7) 36 1020
- V01,V02,V03,V04
- 36 9789
- V05,V06

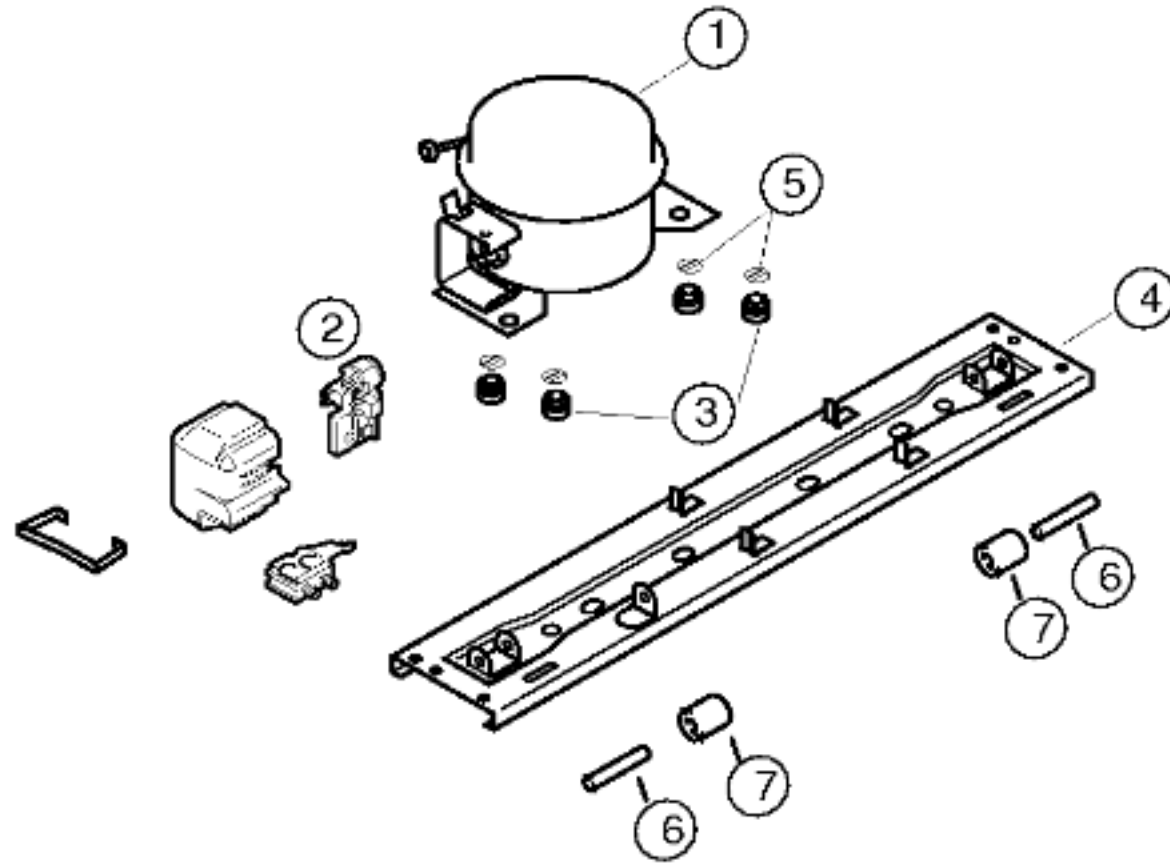

Pos.	V01,V03	V2,4,5,6	
	Danfoss	MATS	
	NL7FT	DD66C	
1	14 1810	14 2136	
2	16 5570	18 7957	
3	16 3427		
4	35 4158		
5	17 1519		
6	18 1014		
7	17 1318		
8			
9			
10			
11			
12			

TECHNISCHE DATEN/TECHNICAL DATA/TEKNIK BILGILER			
	V01/V03	V02,4,5,6	
Verdichter/Compressor/Kompresör	Danfoss	Matsushita	
Typ/Type/Tip	NL7FT	DD66C14GAX5	
Förderleistung/Delivery/Verim/h			
Anlaufstrom/Starting current/Giris akimi	A	11.4	9.94
Widerstand/Resistance/Rezistans	Ohm	10.7	10.55
Hi/aux.		13	19.2
Temp. Reyley/Thermostat/Termostat	RANCO	RANCO	
Typ/Type/Tip	K60/P1102	K60	
Reglerstellung/Position/Termostat pozisyonu	MAX MIN		
Schaltwerte/Actma kapama degerleri	..ein/acma °C	-15.5 -2.5	
Valeurs de commutation/Termostat degeri	..aus"/kapama	-26.0 -9.0	
(..abtaven' od)	..alarm'		
Füllmenge/Fill. quantity/ Dolum miktarı	R134a	g	*
Anschlusswert/Comm. load/Giris gucu	W	*	183
Heizung/Heater/Rezistans			
Widerstand/Resistance/Direnc	Ohm		
Leistung/Power/Guc	W		
Ventilador/Blower/Vantilatör			
Widerstand/Resistance/Rezistans	Ohm		
Magnetventil/Magnetic valve/Manyetik valf			
Widerstand/Resistance/Rezistans	Ohm		
Spannung/Voltage/Gerilim	V		
Temp. Reyley/Thermostat/Termostat			

* Siehe Typenschild/Mamul etiketine bakınız